



FORCE America Inc.

ULTRAKOOL Operator's Manual

FORCE America UK12-70-12VDC-BTC-PC Operator's Manual



ULTRA KOOL



The High Performance, Compact Cooling System

Table of Contents

TABLE OF CONTENTS	2
UK12-70-12VDC-BTC-PC – MODEL CODE BREAKDOWN UK12-70-12VDC-BTC-PC – EXPLODED PARTS VIEW	3
UK12-70-12VDC-BTC-PC – BILL OF MATERIAL	4
UK12-70-12VDC-BTC-PC – DIMENSIONS	5
UK12-70-12VDC-BTC-PC – ELECTRICAL START OPTIONS	6
ELECTRICAL KIT COMPONENTS.....	10
UK12-70-12VDC-BTC-PC – TYPICAL PLUMBING LAYOUT	11
UK12-70-12VDC-BTC-PC – STARTUP PROCEDURE STEPS.....	12
UK12-70-12VDC-BTC-PC – MAINTENANCE RECOMMENDATIONS.....	13
UK12-70-12VDC-BTC-PC – TROUBLESHOOTING	13
UK12-70-12VDC-BTC-PC – PRODUCT INFORMATION	14
MA-48 - HYDRAULIC COOLER SPECIFICATIONS	15
CONTACT US	16


Warranty Disclaimer

Seller warrants that any goods sold by Seller to Buyer shall be free from defects in material and workmanship for a period of one (1) year from the date of delivery. THIS WARRANTY SHALL BE THE SOLE AND EXCLUSIVE WARRANTY MADE BY SELLER TO BUYER. SELLER HEREBY DISCLAIMS ANY IMPLIED WARRANTIES, INCLUDING, WITHOUT LIMITATION, ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.


ULTRA KOOL

The High Performance, Compact Cooling System

UK12-70-12VDC-BTC-PC – Model Code Breakdown

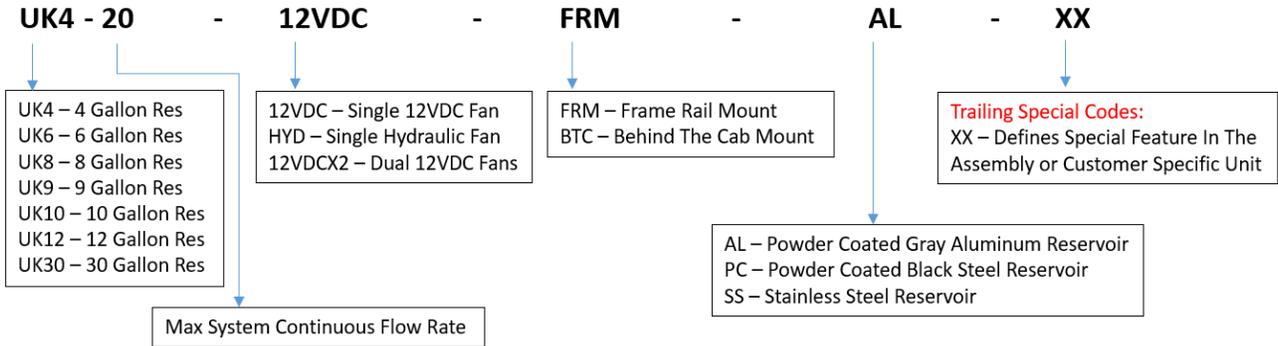

UK12-70-12VDC-BTC-PC – Exploded Parts View

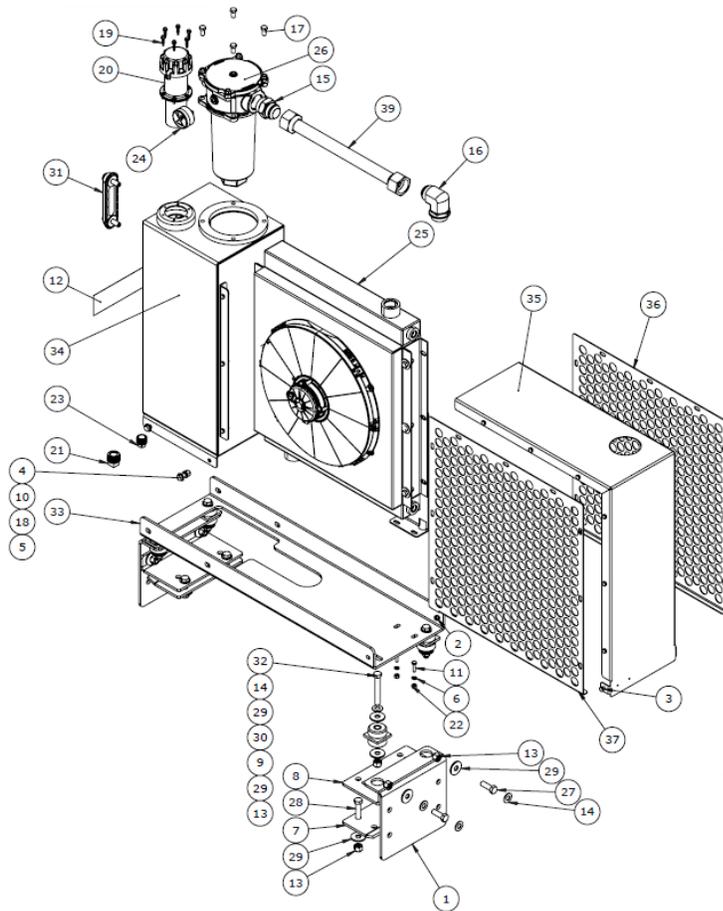

ULTRA KOOL



The High Performance, Compact Cooling System

UK12-70-12VDC-BTC-PC – Bill of Material


ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	1010293	BRACKET, FRAME MOUNTING	2
2	1010306	1/4"-20 HEX NUT, 18-8 STAINLESS	20
3	1010557	1/4"-20 X 3/4" HHCS, 18-8 STAINLESS	20
4	1010558	3/8"-16 X 1-1/4" HHCS, 18-8 STAINLESS	4
5	1010560	3/8"-16 NYLON-INSERT HEX LOCK NUT, 18-8 STAINLESS	4
6	1010561	1/4" SCREW SIZE SPLIT LOCK WASHER, 0.49" OD, 18-8 STAINLESS	2
7	1010689	BRACKET, FRAME CLAMP	2
8	1010690	ANGLE, FRAME CLAMP	2
9	1010707	SPACER, ISOLATOR MOUNT	4
10	1010799	3/8" STAINLESS STEEL WASHER	8
11	1010801	1/4"-20 X 1" HHCS, 18-8 STAINLESS	2
12	1011613	ULTRAKOOL LOGO DECAL	1
13	1011751	1/2"-13 NYLON-INSERT HEX LOCK NUT, GR8, ZINC	12
14	1011765	1/2" SCREW SIZE FLAT WASHER, STEEL	18
15	1013967	FITTING STRAIGHT -20 MJIC / -20 MORB	1
16	1014335	FITTING 90 DEG -20 MJIC / -20 MORB	1
17	1015084	3/8"-16 X 3/4" HHCS, 18-8 STAINLESS	4
18	1015103	3/8" SCREW SIZE SPLIT LOCK WASHER, 0.68" OD, 18-8 STAINLESS	4
19	1015115	#12-14 X 1" SELF DRILLING SCREW, UNSLOTTED HEX WASHER HEAD, ZINC	6
20	1028135	RAISED FILLER BREATHER (ZINGA)	1
21	1030846	1 NPT SQUARE HEAD PLUG	1
22	1066875	1/4-20 NYLON INSERT HEX LOCK NUT, SS	2
23	1067982	PLUG, MAGNETIC SQUARE HEAD, 3/4"-14 NPTF, STL	1
24	1086823	0-60 PSI BYPASS GAUGE - 1/8 NPT	1
25	1087061	MA-48-2-4A	1
26	1090446	TANK MOUNTED FILTER W/ELEMENT ENDURAGUARD (ZINGA)	1
27	1096207	1/2"-13 X 1-1/2" HHCS, GR8, ZINC	4
28	1096208	1/2"-13 X 2" HHCS, GR8, ZINC	4
29	1096389	1/2" SCREW SIZE FENDER WASHER, 1.50" OD, 0.125" THICK, ZINC	16
30	1097650	ISOLATOR, BONDED BUSHING & SNUBBER, 250LBS/IN SPRING RATE (H.A. KING)	4
31	1102641	5" SIGHT/TEMP GAUGE, M12X1.75, PLASTIC GUARD, ZINGA	1
32	1112688	1/2"-13 X 3-1/2" HHCS, GR8, ZINC	4
33	1187332	CRADLE,ULTRAKOOL, PC	1
34	1187333	WELDMENT, RES-12 HYDRAULIC TANK, PC	1
35	1187340	WELDMENT, COOLER GUARD, ULTRAKOOL, PC	1
36	1187341	FFP, PANEL, LEFT, PC	1
37	1187342	FFP, PANEL, RIGHT, PC	1
38	1187477	COOLER MOUNT, ULTRAKOOL STL	1
39	1191535	ASSEMBLY, TUBE, ULTRAKOOL SS	1

ULTRA KOOL



The High Performance, Compact Cooling System


UK12-70-12VDC-BTC-PC – Dimensions

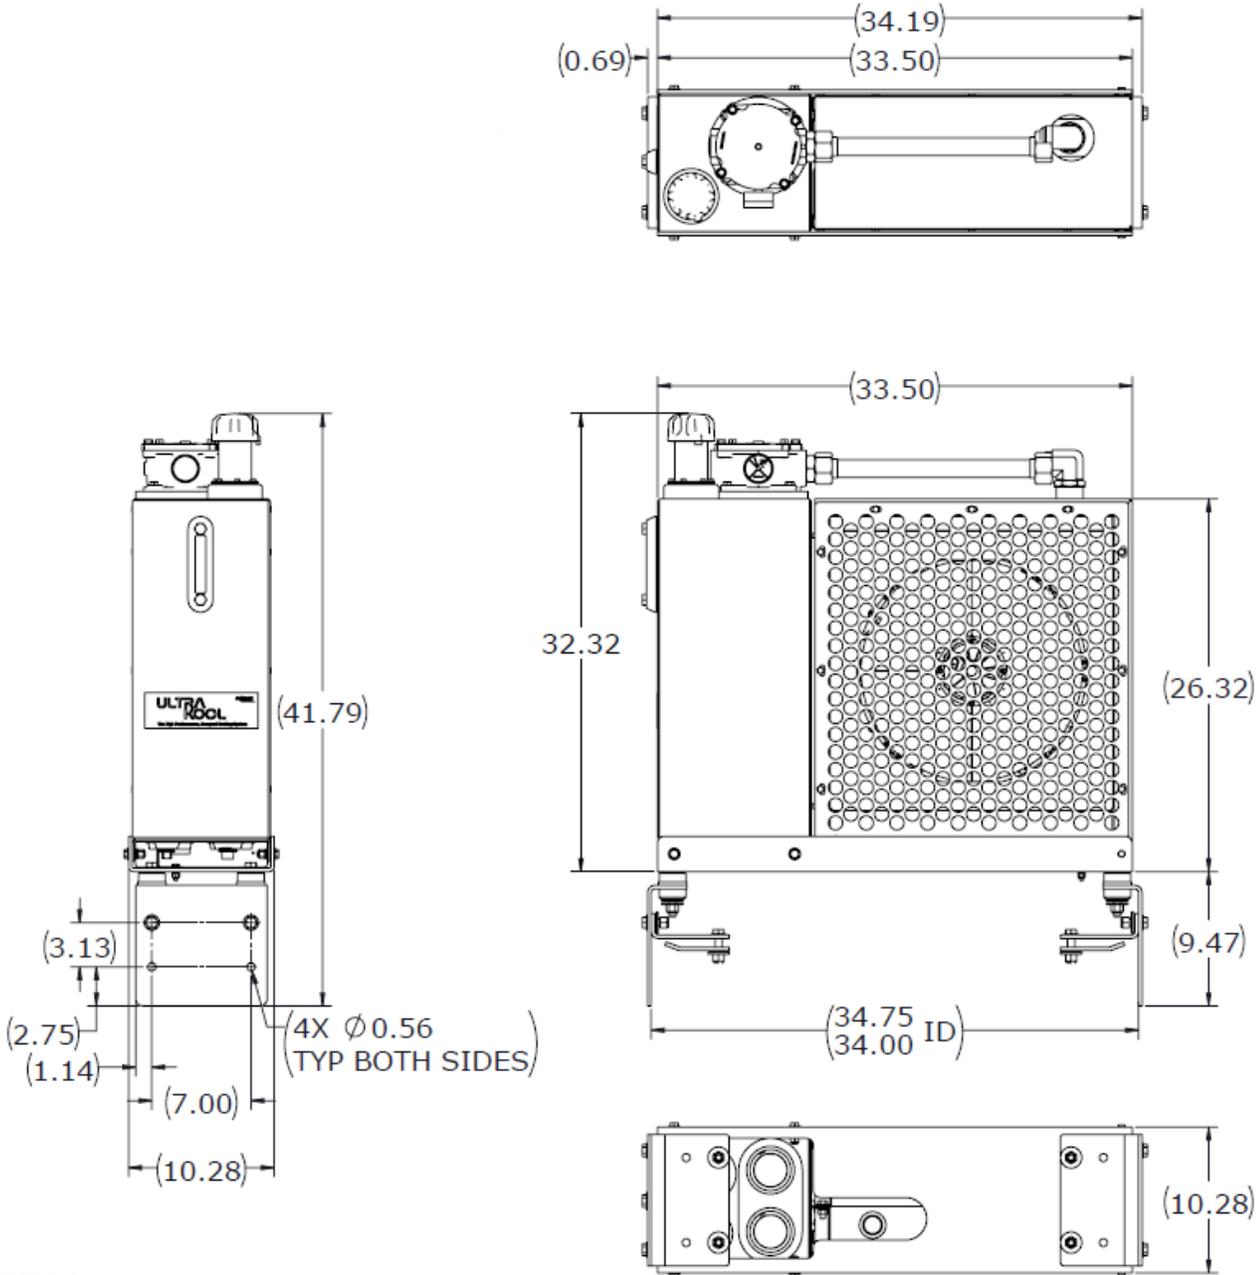


ULTRA KOOL

The High Performance, Compact Cooling System

UK12-70-12VDC-BTC-PC – Electrical Start Options

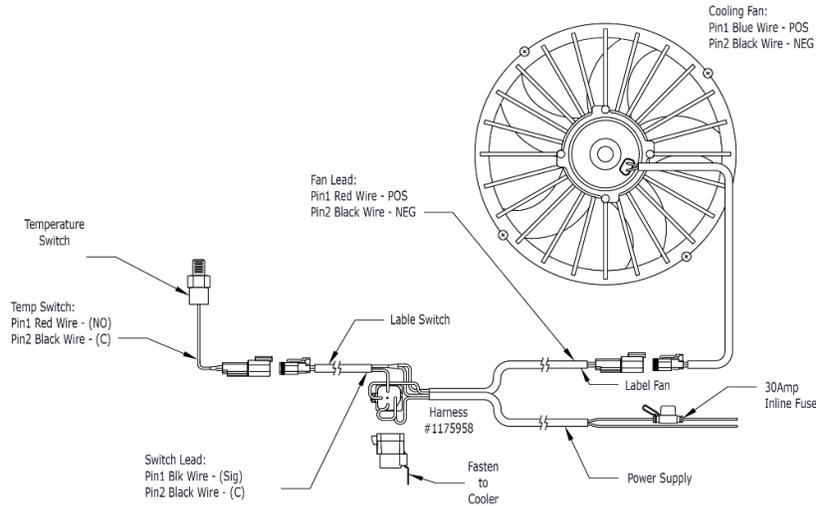


Temperature Switch Fan Activation

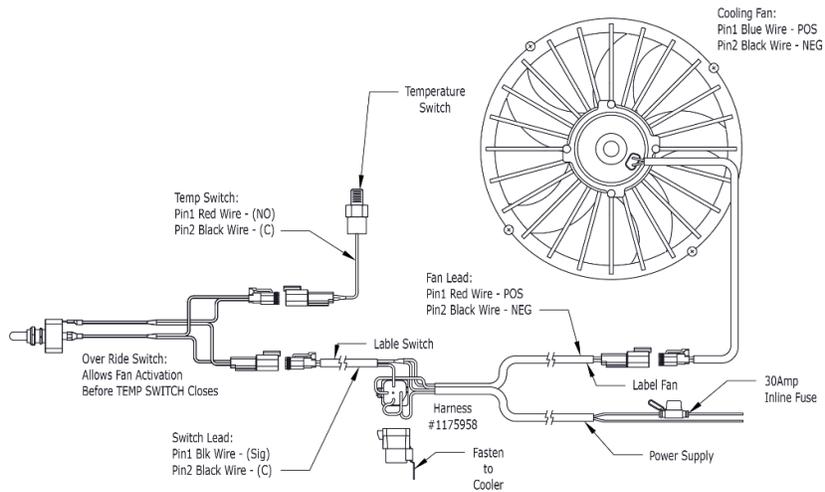


Temperature Switch Fan Activation W/Override

ULTRA KOOL

The High Performance, Compact Cooling System

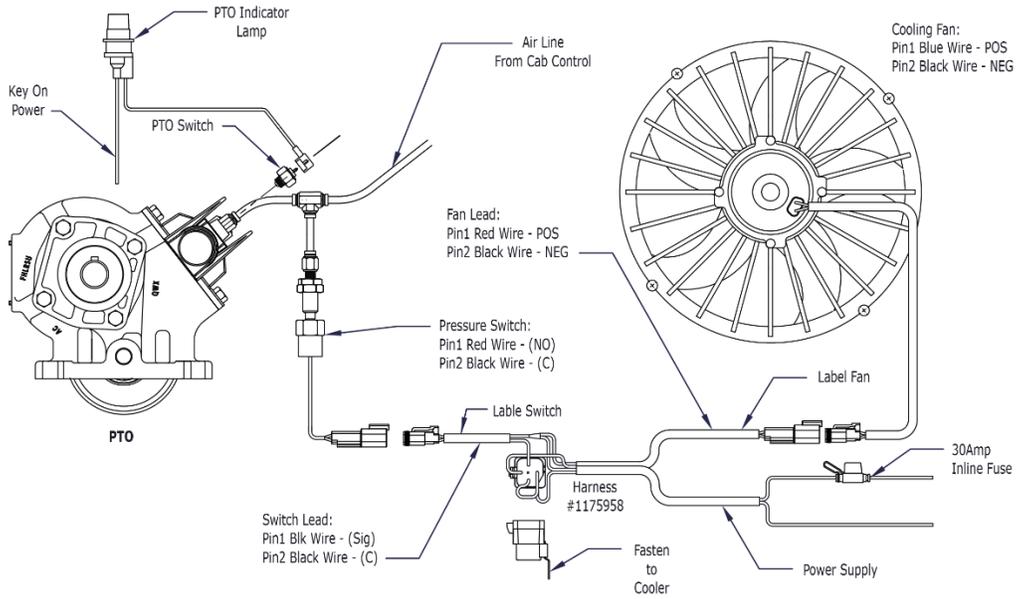


Air Shift PTO Fan Activation

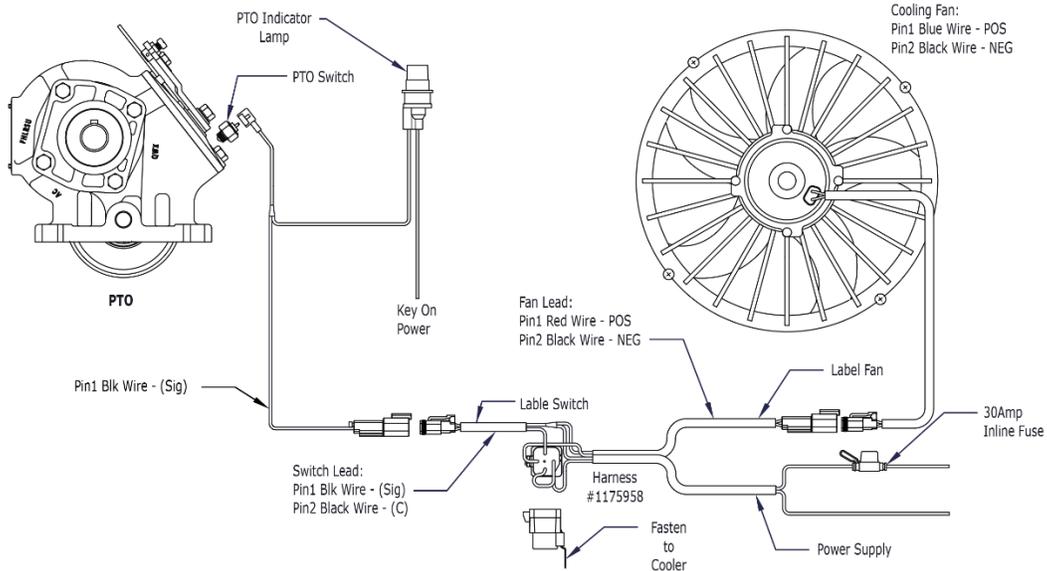


Cable Shift PTO Fan Activation

ULTRA KOOL

The High Performance, Compact Cooling System

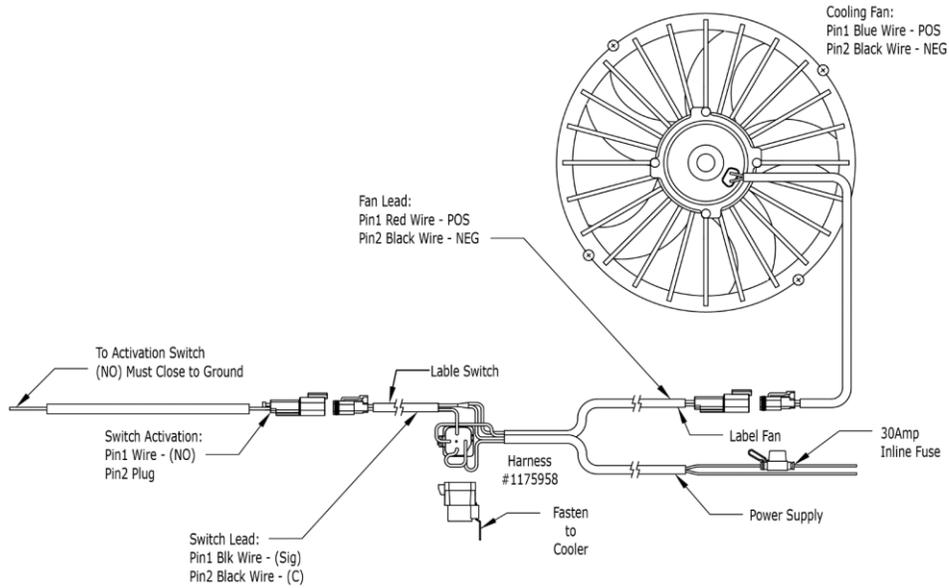


Grounding Switch Fan Activation

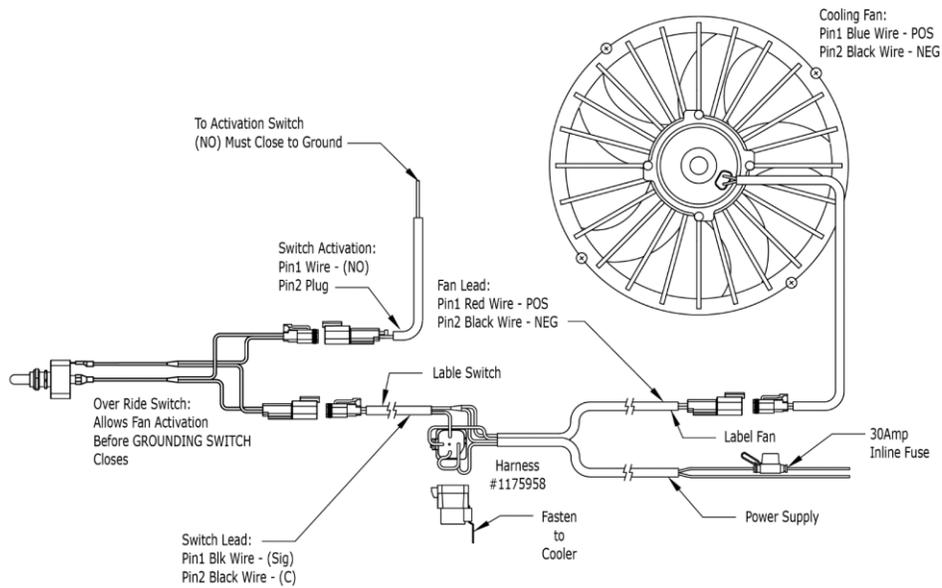


Grounding Switch Fan Activation W/Override

ULTRA KOOL

The High Performance, Compact Cooling System

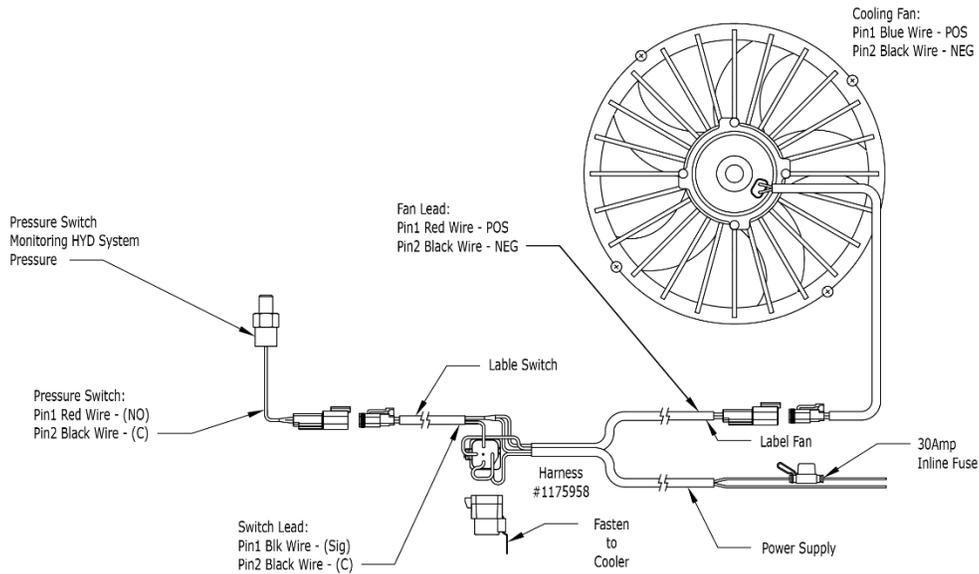

Pressure Switch Fan Activation

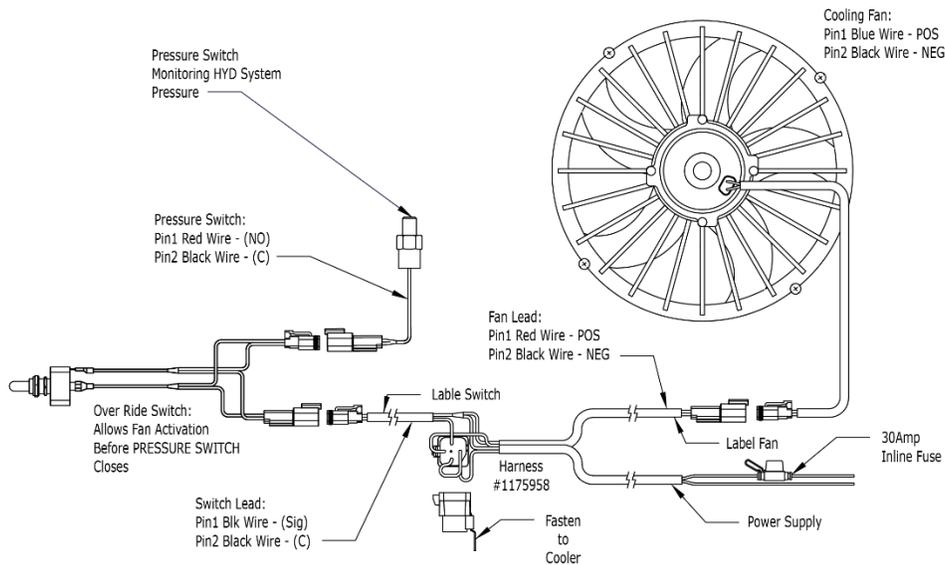

Pressure Switch Fan Activation W/Override

ULTRA KOOL



The High Performance, Compact Cooling System


ELECTRICAL KIT COMPONENTS

ITEM	DESCRIPTION	QTY
MAIN HARNESS		
1175958	Harness, Main, Cooler, Deutsch, w/ Relay, 144" (Used with MAR-12-225715)	1.00
PRESSURE SWITCH		
1069985	Pressure Switch, Set 25 PSI, Female Deutsch DT04-2P Connection	1.00
TEMPERATURE SWITCH		
1128418	-8 ORB 120°F Temp Switch, 5/8" Long Probe, N.O., 18" Flying Lead	1.00
PLUG CONNECTOR KIT (DT06-2S)		
1017929	Connector, DT, Plug, 2 Way, Size 16, DT06-2S	1.00
1040708	Deutsch Wedglock for DT06-2S	1.00
1100400	Deutsch Female Socket, 1062-16-0122	2.00
RECEPTICAL CONNECTOR KIT (DT04-2P)		
1017930	Connector, DT, Receptacle, 2 Way, Size 16, DT04-2P	1.00
1017933	Wedglock, Receptacle, DT, 2 Way, Size 16, W2P	1.00
1018110	Deutsch male pin, 1060-16-0122	2.00
SAMPLE KIT FOR TEMPURATURE ACTIVATION		
1175958	Harness, Main, Cooler, Deutsch, w/ Relay, 144" (Used with MAR-12-225715)	1.00
1128418	-8 ORB 120°F Temp Switch, 5/8" Long Probe, N.O., 18" Flying Lead	1.00
1017930	Connector, DT, Receptacle, 2 Way, Size 16, DT04-2P	1.00
1017933	Wedglock, Receptacle, DT, 2 Way, Size 16, W2P	1.00
1018110	Deutsch male pin, 1060-16-0122	2.00

ULTRA KOOL

The High Performance, Compact Cooling System

UK12-70-12VDC-BTC-PC – Typical Plumbing Layout

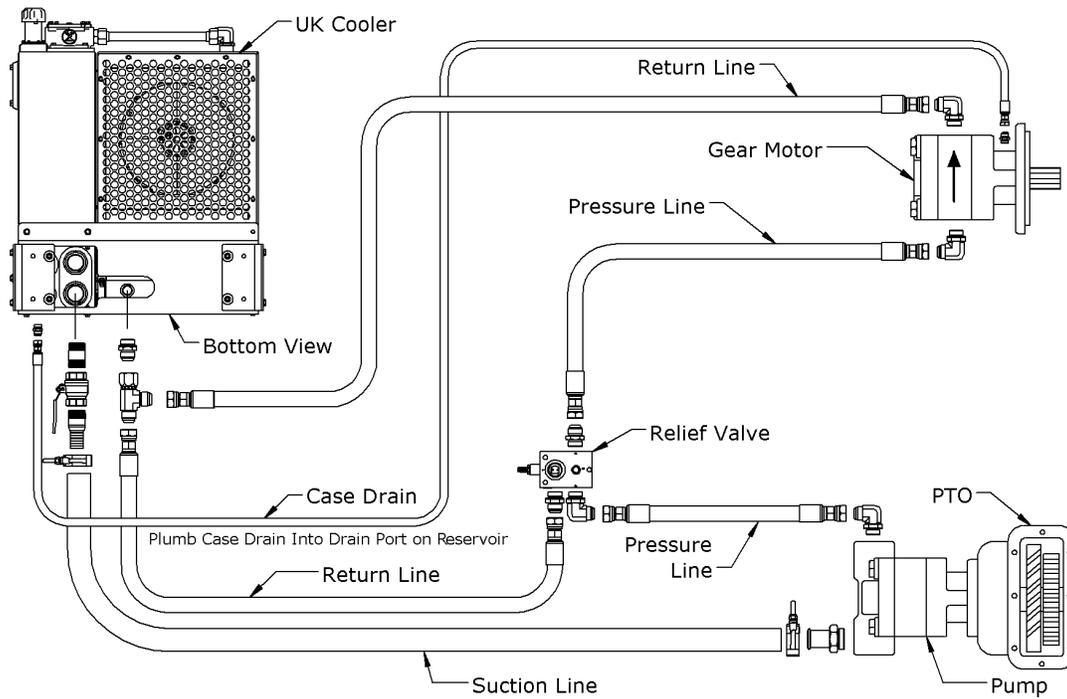

ULTRA KOOL



The High Performance, Compact Cooling System

UK12-70-12VDC-BTC-PC – Startup Procedure Steps

1. Mount unit to truck chassis.
2. Plumb all hydraulic lines per plumbing diagram and application diagrams.
3. Fill the Reservoir to the high end of the sight gauge.
4. Engage PTO at low RPM levels.
5. Continually add oil to make sure oil level stays visible within the sight gauge.
6. After the oil level stays steady check for leaks and repair before continuing.
7. Verify fan operation for either hydraulic or electric fans.
8. Slowly increase PTO speed to get desired pump RPMs.
9. Run system until oil gets to temp (electric) and verify oil is being cooled (both fan types). It should take roughly 5-10 minutes to verify.
10. Operate all functions of the system to verify the system is properly bled of air.
11. Disengage PTO.
12. The system is functional and ready for full operation.

UK12-70-12VDC-BTC-PC – Maintenance Recommendations

General – Look over your Ultra-Kool system before each use to make sure there are no leaks, and all components are good working order.

Oil – Replace every 12 months or sooner depending on operational conditions. Only oil based hydraulic fluids should be used in this system. Please contact FORCE America if you have any questions related to the fluid you'd like to use in your system.

Filters – Replace as indicated by the gauge on the return filter housing. Replacement filter part number can be obtained from the parts breakdown diagram.

Hoses – Replace hoses due to any leaks or a visual inspection revealing abrasions or cracking.

Cooler – Rinse every 3-6 months with low pressure water (under 200 PSI). When used in dirty environments, it is recommended to rinse the cooler more frequently for optimal performance.

UK12-70-12VDC-BTC-PC – Troubleshooting

Cooling – If system is not cooling properly check the following items.

- Clean or rinse the cooler to remove debris
- Check to make sure the fan is engaging and functioning properly
- Check for additional heat coming from relief valves not functioning properly
- Check to make sure you don't have pump cavitation in your system


Noise – If the system is making excessive noise check the following items.

- Fan is engaging and functioning correctly
- Check oil level is in the center of your sight gauge
- Make sure all bolts are securely fastened on the unit


ULTRA KOOL

The High Performance, Compact Cooling System

MA-48 - Hydraulic Cooler Specifications

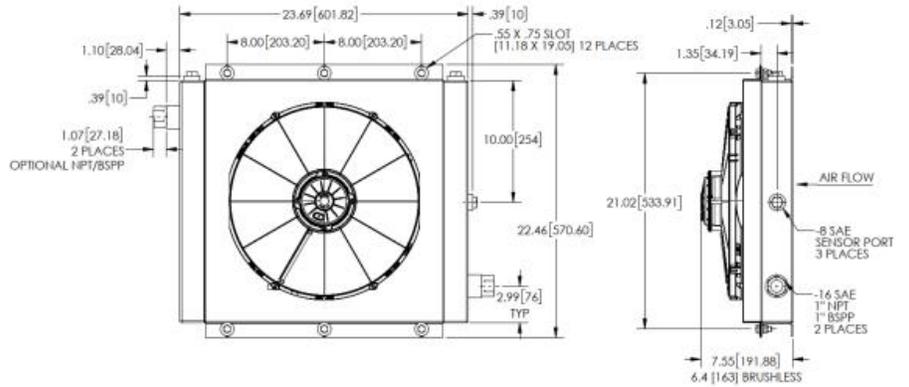

MA Models - DC Fan Assemblies

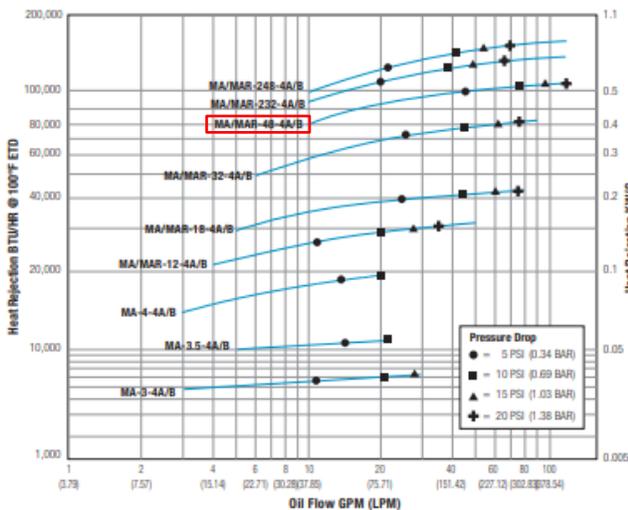

Model	DC Amp Draw		Approx. Shipping Weight LBS (KG)
	12V	24V	
MA-3	5.7	3.6	6 (2.72)
MA-3.5	12.5	6.3	9 (4.08)
MA-4	12.5	6.3	16 (7.26)
MA-12	12.5	6.3	19 (8.62)
MA-18	10.6	5.3	23 (10.43)
MA-32	22.2	11.1	28 (12.70)
MA-48	22.2	11.1	45 (20.40)
MA-232	19.3*	9.7*	65 (29.48)
MA-248	19.3*	9.7*	90 (40.80)


*AMP draw listed as per FAN.

ULTRA KOOL



The High Performance, Compact Cooling System

Contact Us

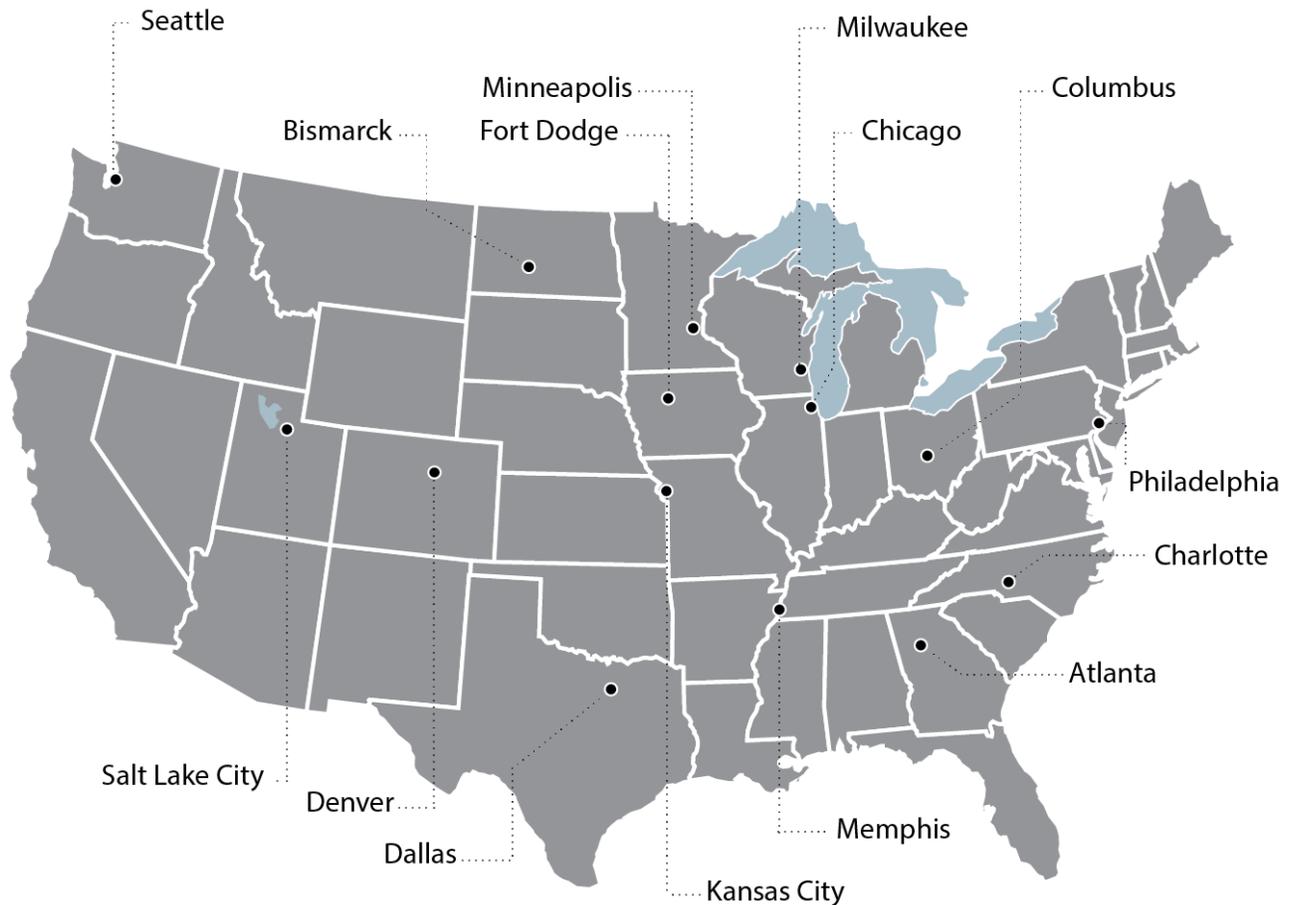

Atlanta, Georgia 888-293-2325
Bismarck, North Dakota 800-624-7568
Charlotte, North Carolina 800-788-8598
Chicago, Illinois 800-433-5765
Columbus, Ohio 888-449-0356
Dallas, Texas 800-893-7225
Denver, Colorado 888-833-7711
Fort Dodge, Iowa 800-362-2994

Kansas City, Missouri 800-383-4724
Memphis, Tennessee 888-845-5876
Milwaukee, Wisconsin 800-722-5844
Minneapolis, Minnesota 800-328-2732
Philadelphia, Pennsylvania 800-492-6621
Salt Lake City, Utah 877-230-0505
Seattle, Washington 800-354-9028